
6 Tankless Units Installation- Common Venting

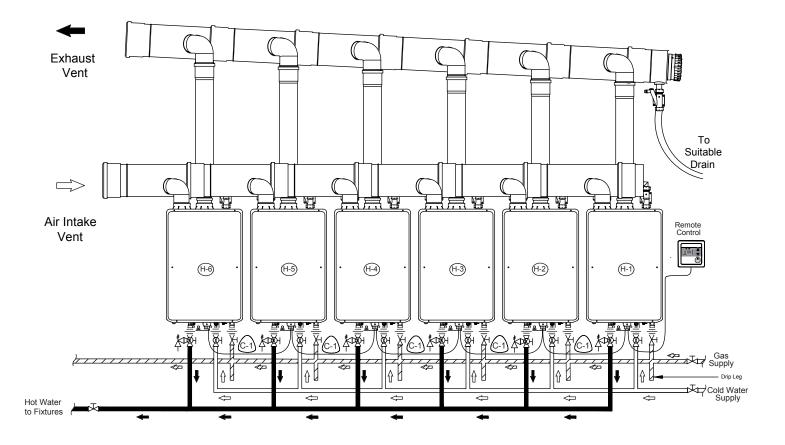

Written System Description	System Components
Six Unit Tankless Installation:	H-1-6: (6) Tankless RTGH-CM95DVLN Water Heaters
Six tankless water heaters shall be installed, connected with	C-1: (5) EZ-Link Cable
EZ-Link cables, a single remote control, and vented to the outside per	(6) Tankless Service Valve Kits (Webstone EXP2 or equivalent)
the Rheem Common Venting Installation instructions. The tankless	(6) Pressure Relief Valve for tankless
units shall be plumbed in parallel with a minimum gas and water	(1) Common Vent 6 Units DV Inline
header of 1" pipe or as code requires. Cold water shall feed the	
tankless units. The tankless units shall supply a single temperature	NOTE: Common Vent is only approved for Natural Gas Applications.
setting of water for application use. Plumbing, pipe size, valves,	Legend Drawing No: 6-Tankless-Units-Installation-Common-Venting
all to be determined by the engineer or installing contractor.	
This drawing is intended as a guide only. It is not to be used as an alternative to	Cold Water Isolator Valve Assembly Valve Cold Water Pipe
a professionally engineered project drawing. This drawing does not imply	Cold Water Isolator Valve Assembly Valve Cold Water Pipe
compliance with local building codes. Installation may vary, depending on	Hot Water Pipe
installation location, and must be done in accordance with all local building codes. Consult with local building officials prior to installation.	Hot Water Isolator Check Valve Union